

FLOOR (Plan View)

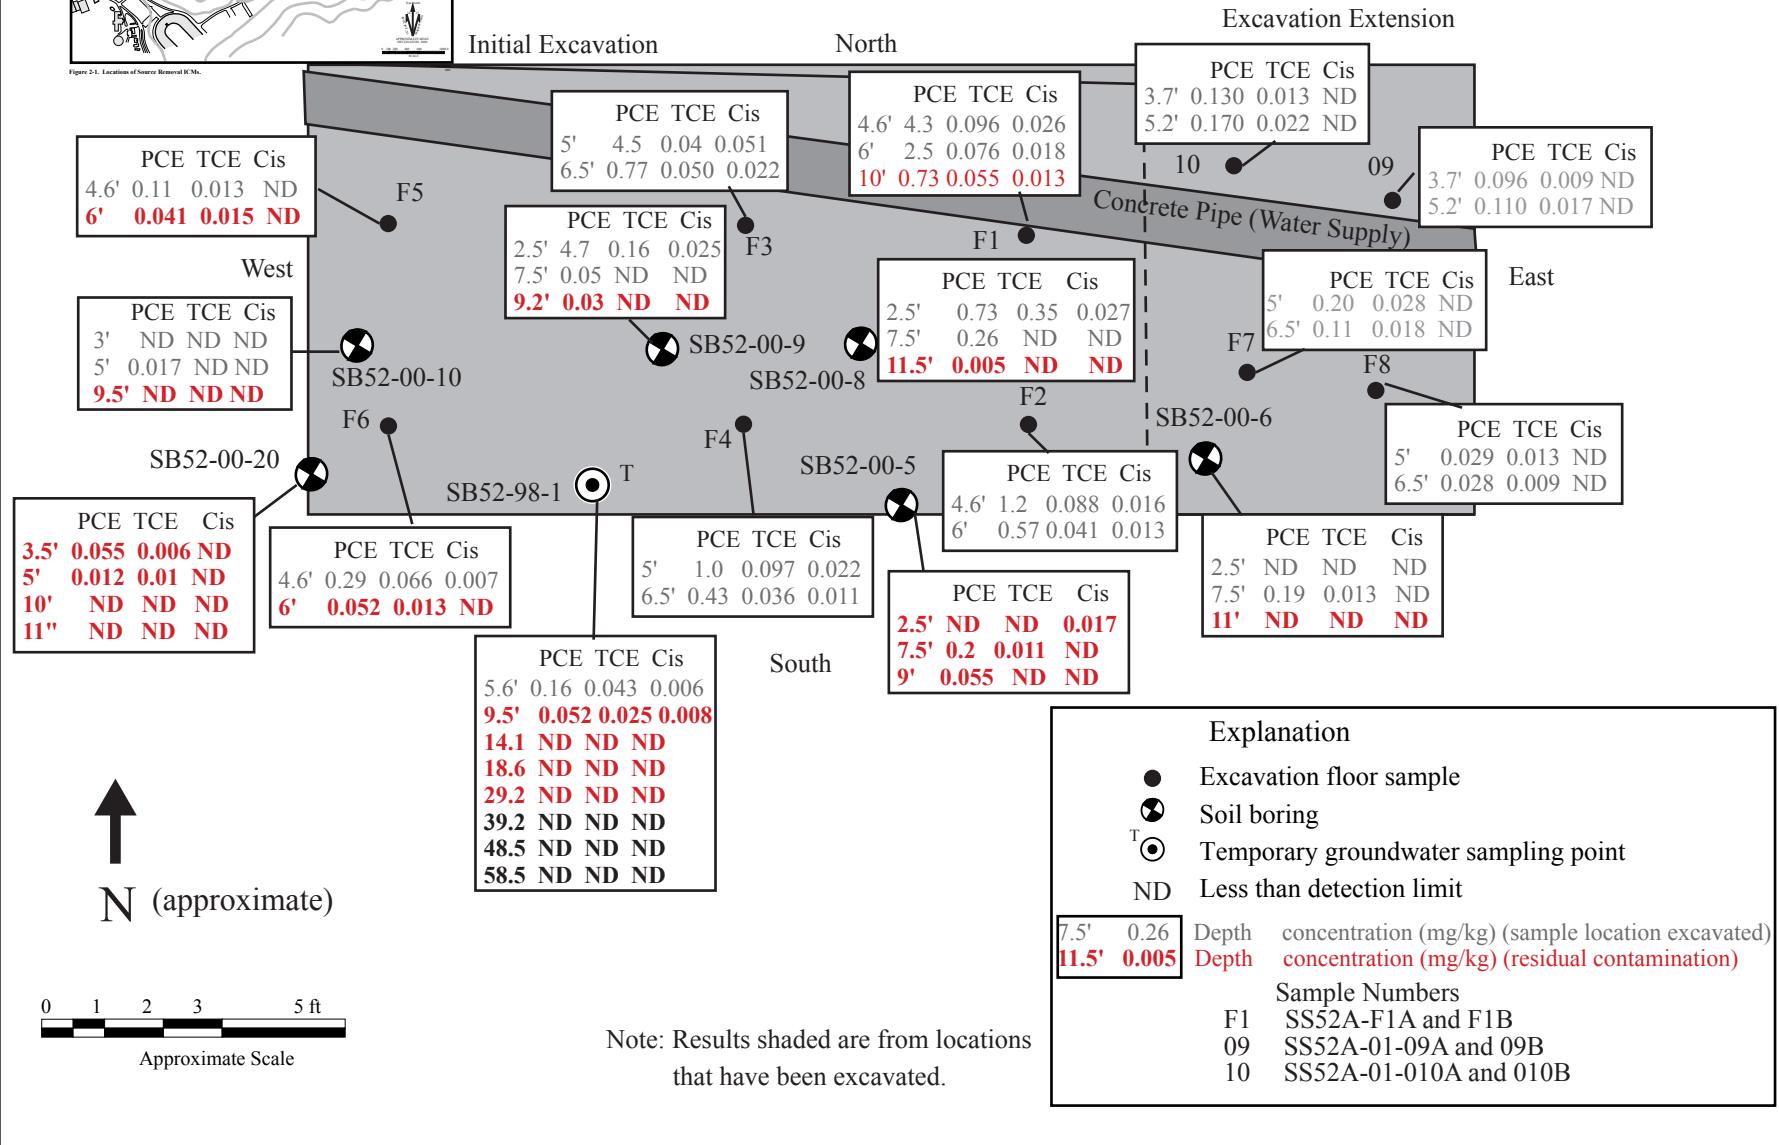


Figure 4.3.5-9a. Concentrations of PCE, TCE, and Cis-1,2-DCE Detected (mg/kg) in Floor Samples, Building 52A Source Area ICM.

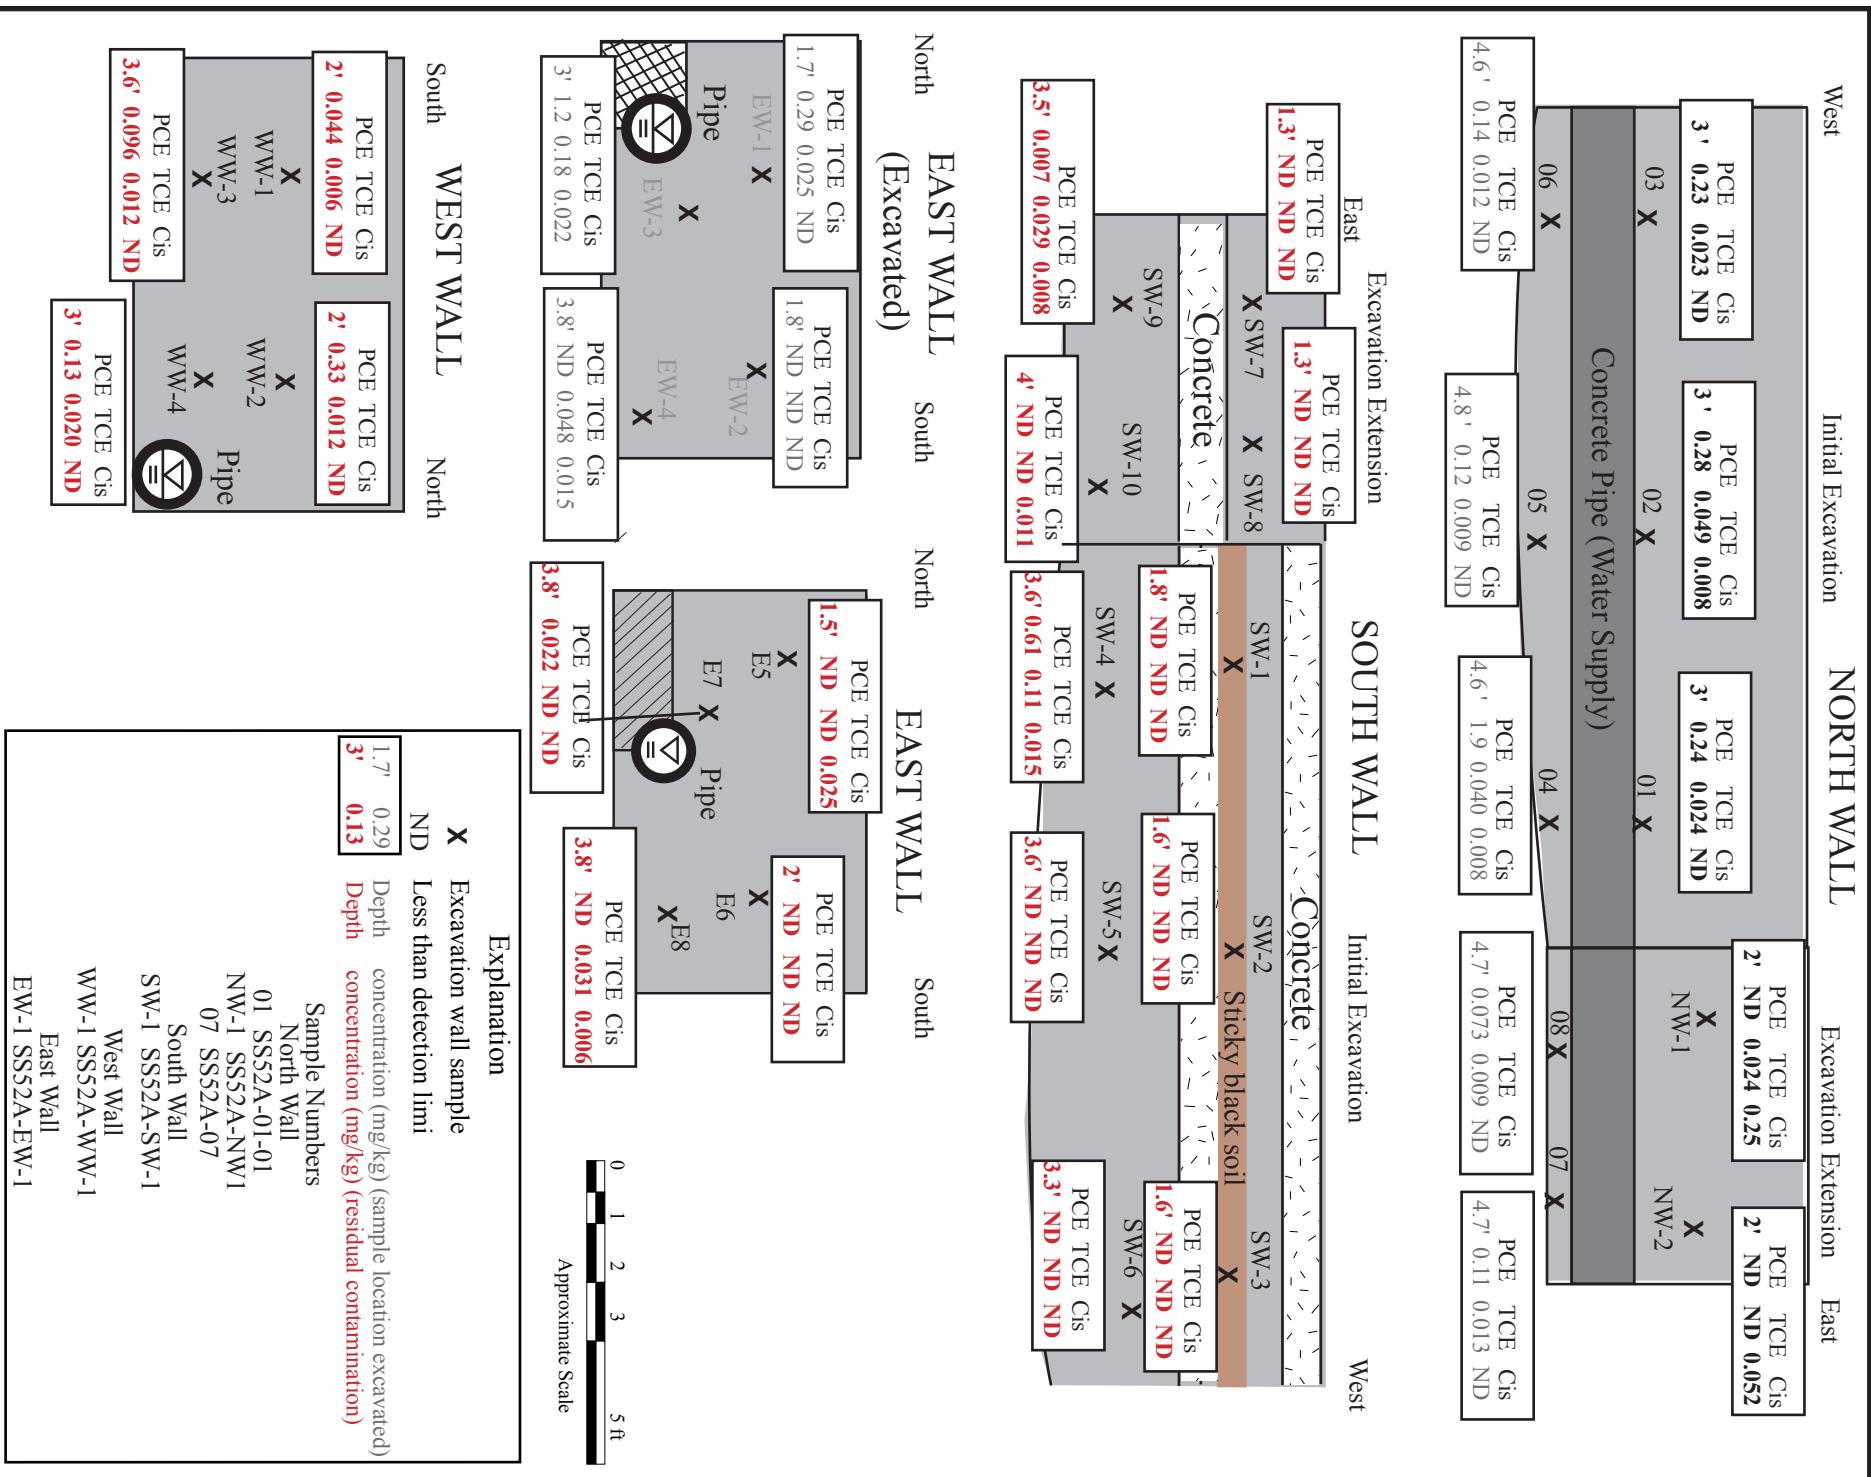


Figure 4.3.5-9b. Concentrations of PCE, TCE, and Cis-1,2-DCE Detected (mg/kg) in Wall Samples, Building 52A Source Area ICM

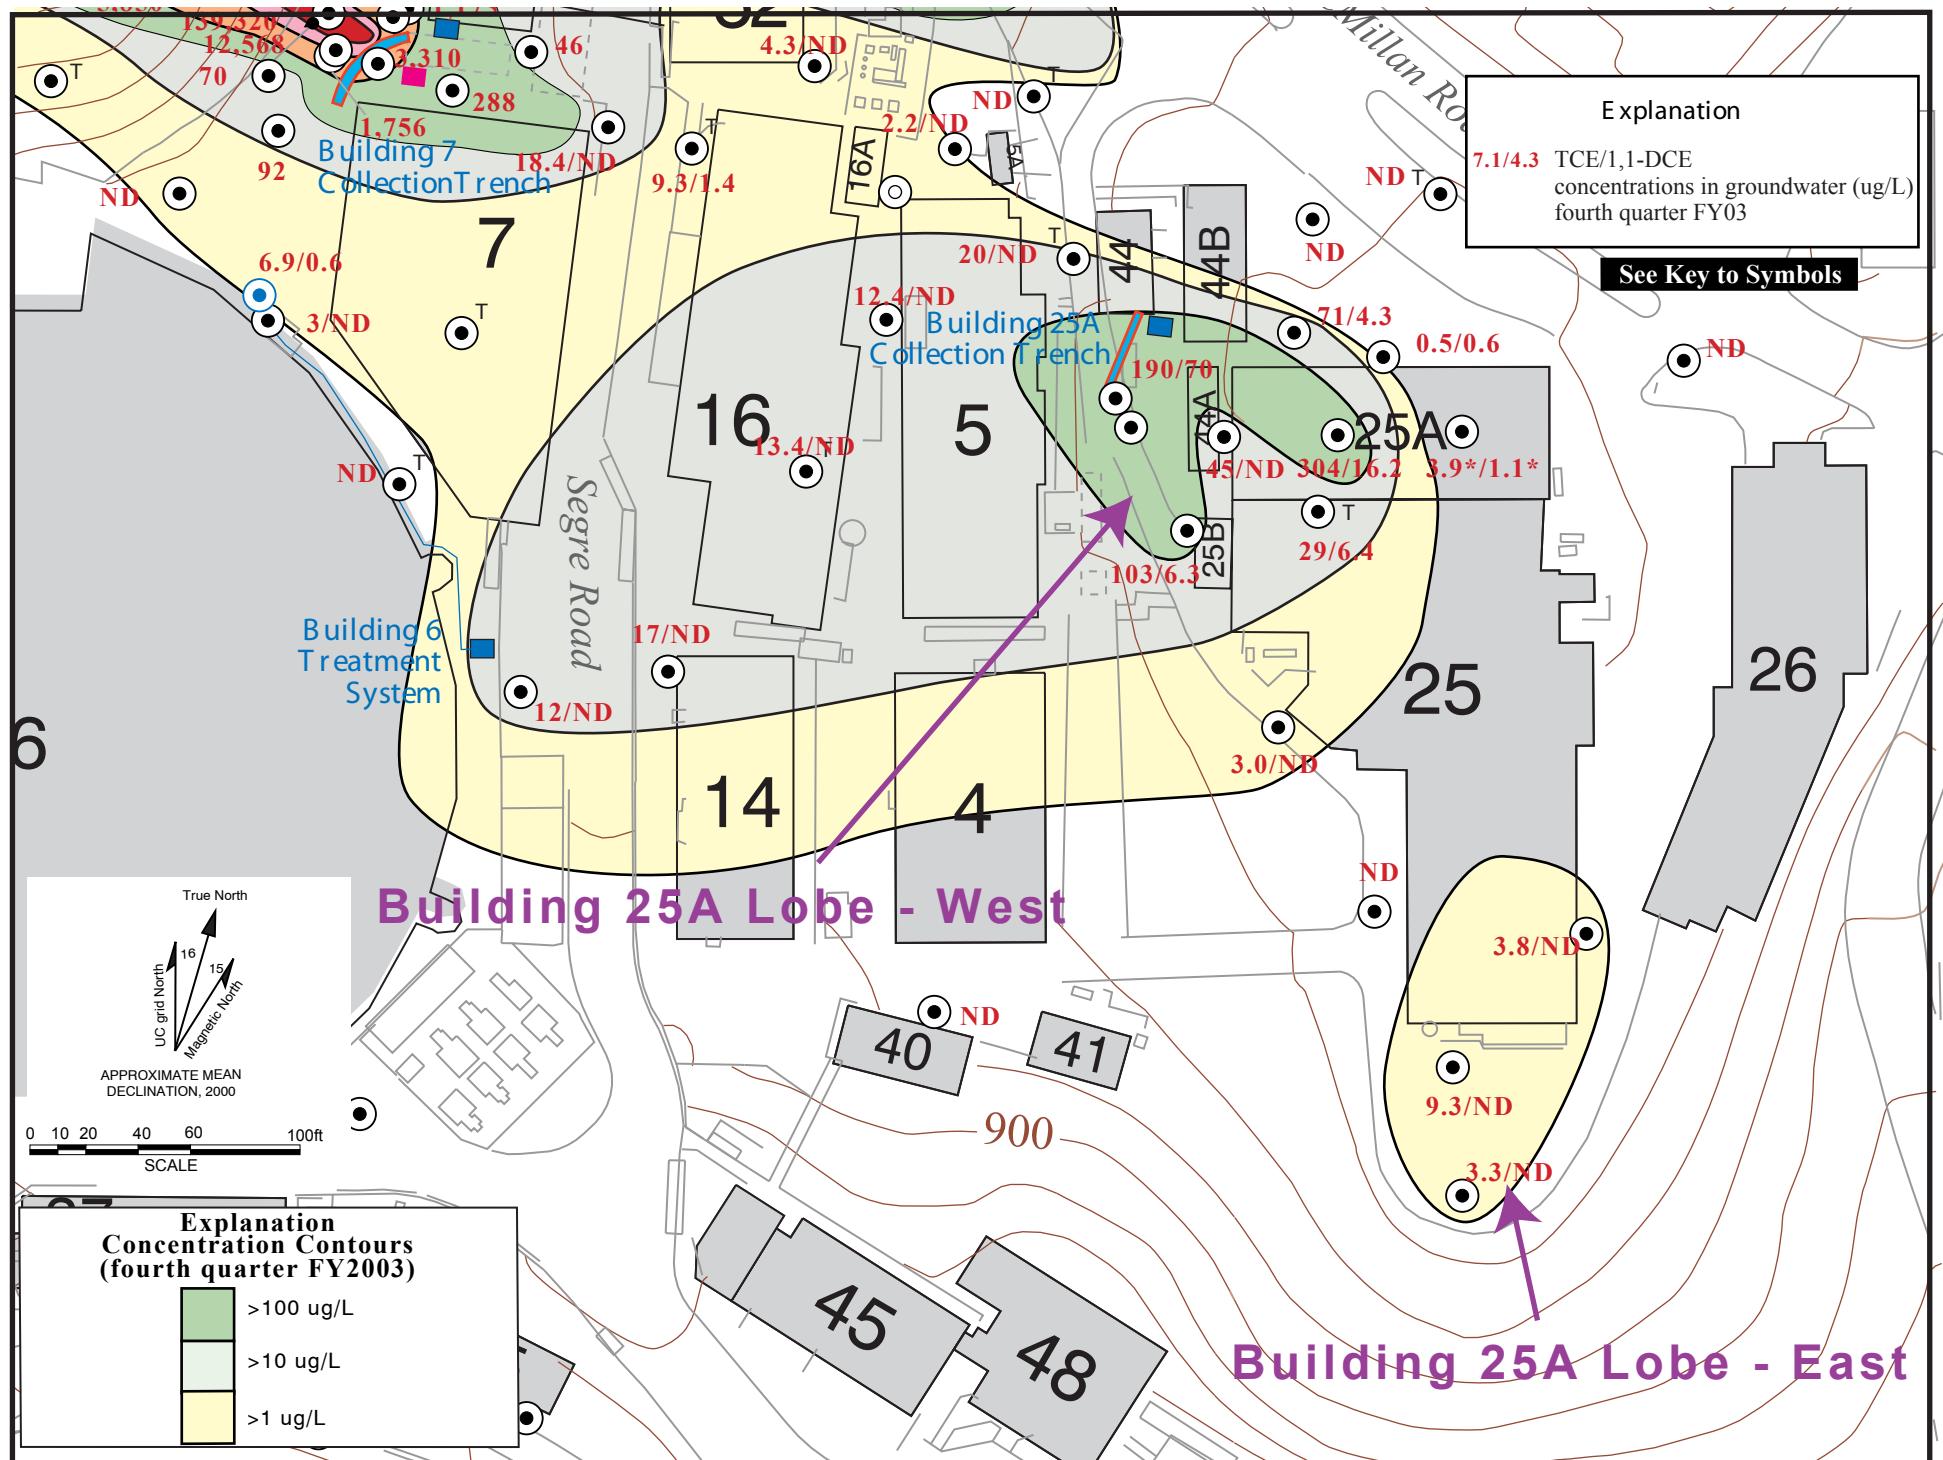


Figure 4.3.6-1. Concentrations of Trichloroethene and 1,1-Dichloroethene in Groundwater (ug/L), Building 25A Lobe Old Town Groundwater Solvent Plume.

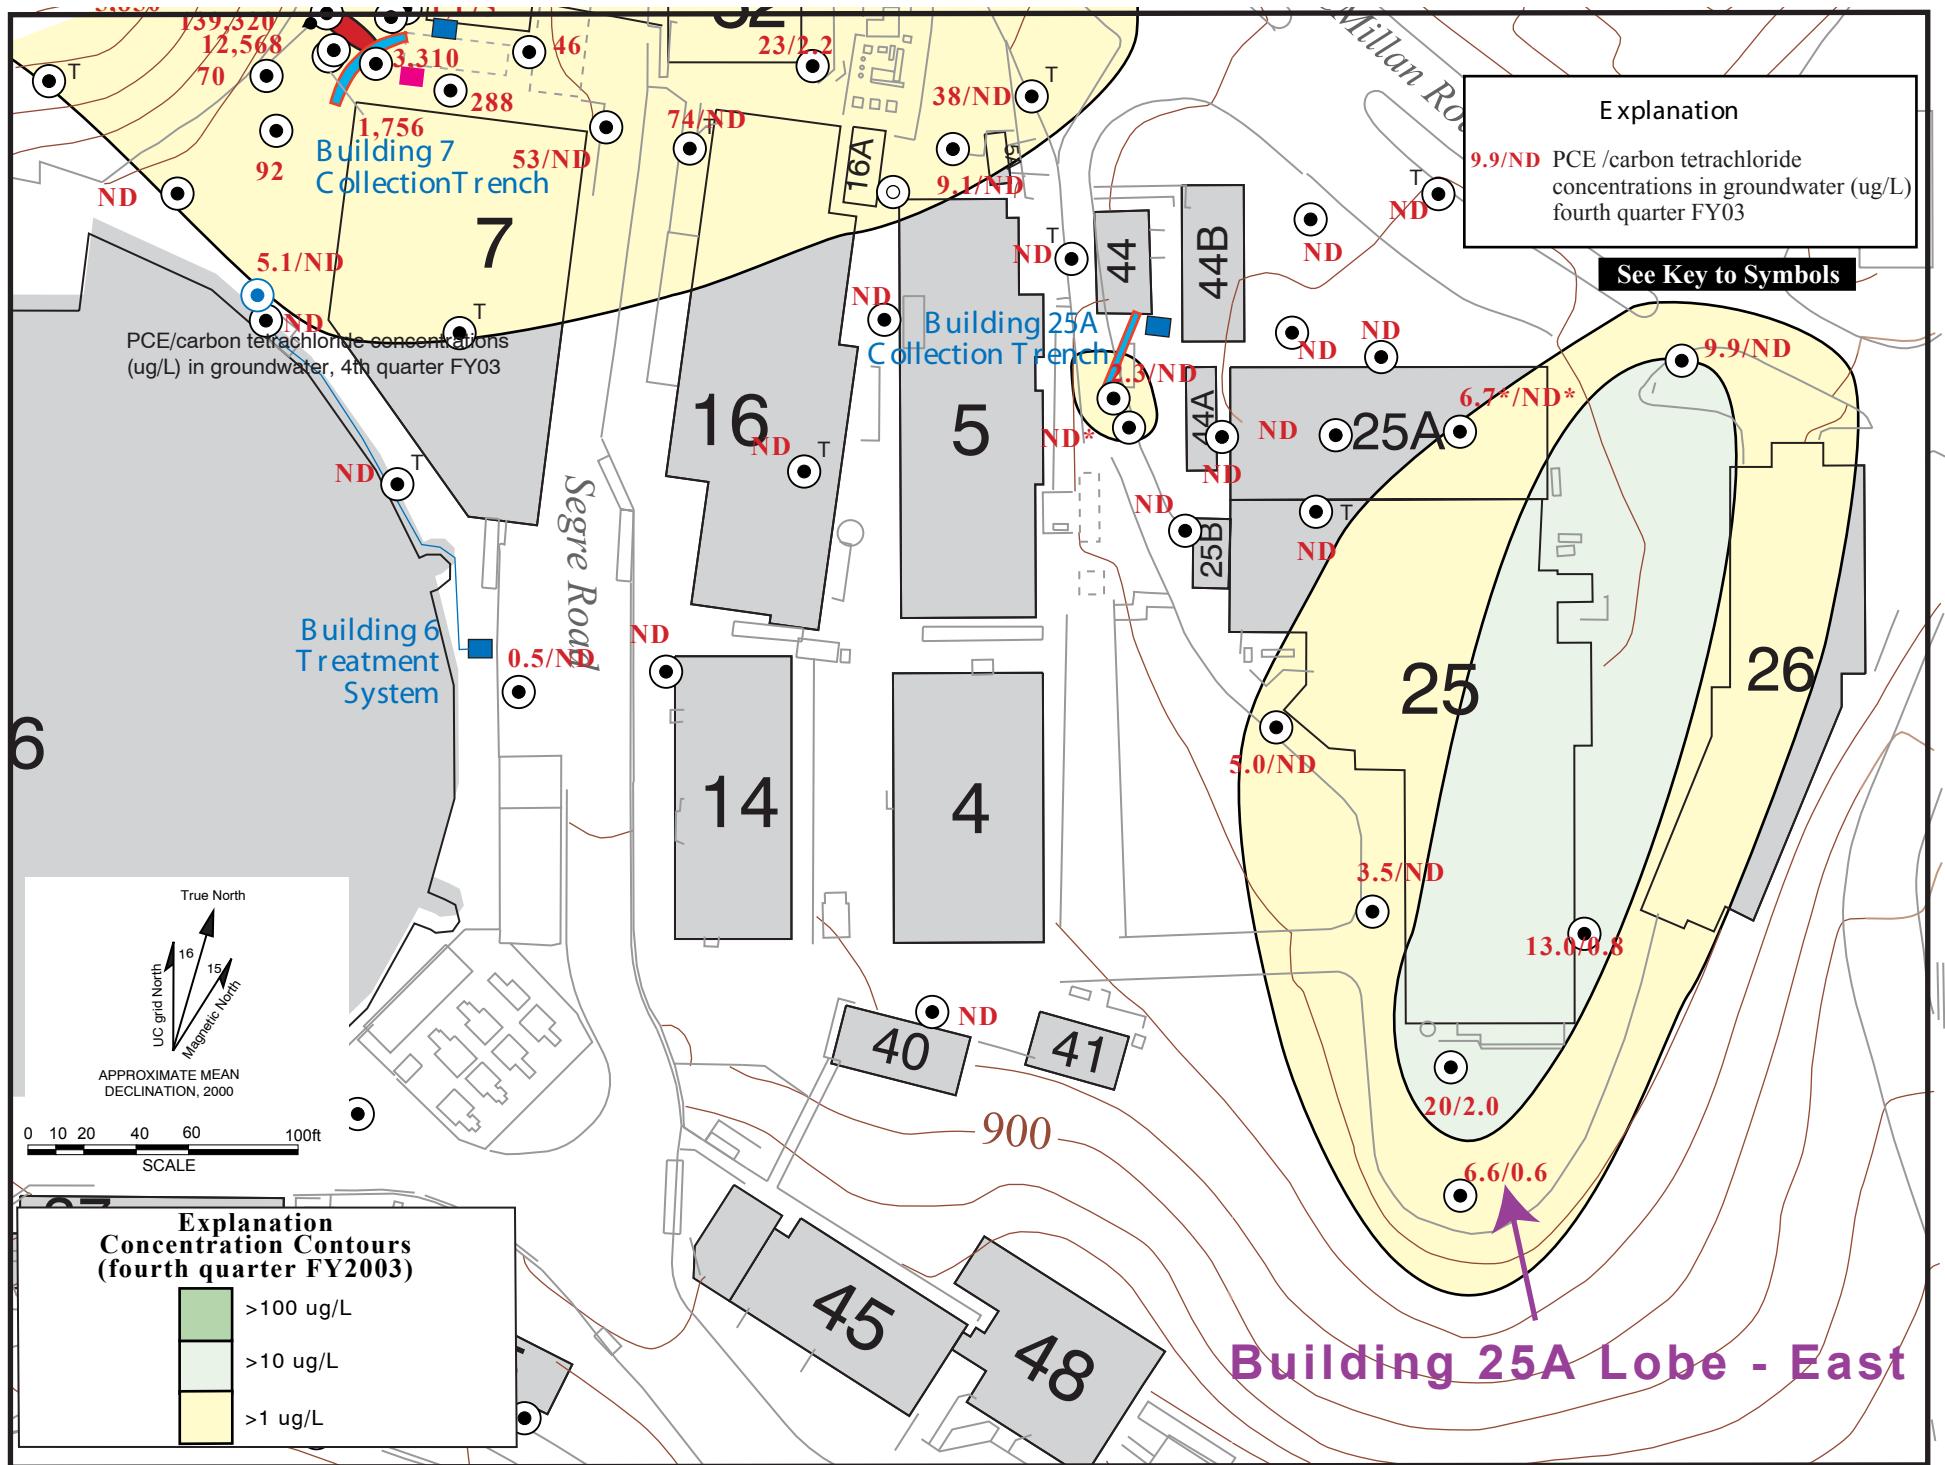


Figure 4.3.6-2. Concentrations of Tetrachloroethene and Carbon Tetrachloride in Groundwater (ug/L), Building 25A Lobe Old Town Groundwater Solvent Plume.